

PERCENT OUTDOOR AIR CALCULATION AND ITS USE

APPLICATION NOTE AF-138 (A4)

The RH720 calculates Percent Outdoor Air (%OA). In order to take advantage of this feature, it is important to first understand what Percent Outdoor Air is, why it is important, and how to use these instruments to calculate %OA.

The Importance of Fresh Outdoor Air

Perhaps the somewhat infamous quote, “The Solution to Pollution is Dilution,” sums up the importance of fresh outdoor air. We may not go as far as to say that indoor environments have “pollution,” but we might want to consider the effects of the indoor air components that cannot be filtered. These include CO₂, body odors, chemicals from photocopiers and cleaners, and other indoor contaminants. Most of these components alone would not affect someone over short periods of time. However, after long periods of exposure, like in a workplace where 40-hour workweeks are typical, these components have the capacity to make occupants tired, nauseous, and otherwise not as productive.

Volume of Fresh Outdoor Air

One method used to calculate the volume of fresh outdoor air entering a system is to conduct a duct traverse of the outdoor air duct intake. However, this is not always feasible, because there may not be sufficient straight ducting to do a good duct traverse¹ of either the return air or the outdoor air. Often, there is not even a duct for outdoor air, so it is essentially impossible to determine the volume of outdoor air that is entering the system.

An alternative way to determine how much fresh outdoor air is entering a space is to use the following equation:

Volume Fresh Outdoor Air = Volume of delivered air x % Outdoor Air of delivered air

The volume of fresh outdoor air entering a space equals the volume of delivered air (ft³/min, m³/hr, m³/min or L/s) times the % outdoor air. Let’s look at each of these items separately.

Total Volume of Delivered Air

The total volume of delivered air is the total volume of both outdoor air and return air entering a space. To determine the total volume of supply air entering a building, do a duct traverse using a TA465 or a PVM620 right after the Air Handling Unit and before the duct branches off. Another method to determine the total volume of delivered air is to use the PH721 capture hood at each supply diffuser and to take the sum of the readings.

Percent Outdoor Air

Percent outdoor air is the % of the total volume of delivered air that is outdoor air. There is more than one way to measure %OA. One method is to use a tracer gas like SF₆. This gas would be used to saturate the system at a set concentration and to record how the concentration decreases over time. Using this information, one can figure out what the %OA is. This can also be done with CO₂ if the concentration is high enough and there are no occupants.

Perhaps a better option is to take three readings of CO₂ concentration and calculate the %OA. The three reading locations include outdoor air, supply air, and return air. Another option is to take temperature readings at those same three locations.

Introducing the Equation

To calculate the %OA, use the following equation for CO₂ or temperature:

$$\%OA = \frac{(X_R - X_S)}{(X_R - X_O)} \times 100\%$$

Where:

X_R = **Return** air CO₂ concentration OR temperature

X_S = **Supply** air CO₂ concentration OR temperature

X_O = **Outdoor** air CO₂ concentration OR temperature

Some Examples

Let's look at an example. An industrial hygienist takes three samples with the following values:

Outdoor air CO ₂ level	= X _O	= 400 ppm
Supply air CO ₂ level	= X _S	= 645 ppm
Return air CO ₂ level	= X _R	= 823 ppm

$$\text{Then } \%OA = \frac{(X_R - X_S)}{(X_R - X_O)} \times 100\% = \frac{(823 - 645)}{(823 - 400)} \times 100\% = \frac{(178)}{(423)} \times 100\% = 42.1\%$$

We can use this equation using temperature measurements, too. Let's say that these measurements are taken in cold climates in the winter:

Outdoor air temperature	= X _O	= 35 °F
Supply air temperature (before conditioning)	= X _S	= 55 °F
Return air temperature	= X _R	= 70 °F

$$\text{Then } \%OA = \frac{(X_R - X_S)}{(X_R - X_O)} \times 100\% = \frac{(70 - 55)}{(70 - 35)} \times 100\% = \frac{15}{35} \times 100\% = 42.9\%$$

We can use the equation using summer temperature measurements as well:

Outdoor air temperature = X_0 = 93 °F
 Supply air temperature (before conditioning) = X_S = 81°F
 Return air temperature = X_R = 70°F

$$\text{Then } \%OA = \frac{(X_R - X_S)}{(X_R - X_0)} \times 100\% = \frac{(70 - 81)}{(70 - 93)} = \frac{(-11)}{(-23)} = 47.8\%$$

Where to Take Measurements

To make sure the %OA measurement is done properly, the readings need to be taken at the appropriate locations. Outdoor air should always be taken away from the building exhaust vents. The location for supply and return may vary if the %OA value you are interested in getting is from using CO₂ or temperature.

For CO₂, the return air reading should be taken inside the return duct or well before the air mixes with the outdoor air. These locations ensure a stable reading. The supply reading should be taken inside the supply duct.

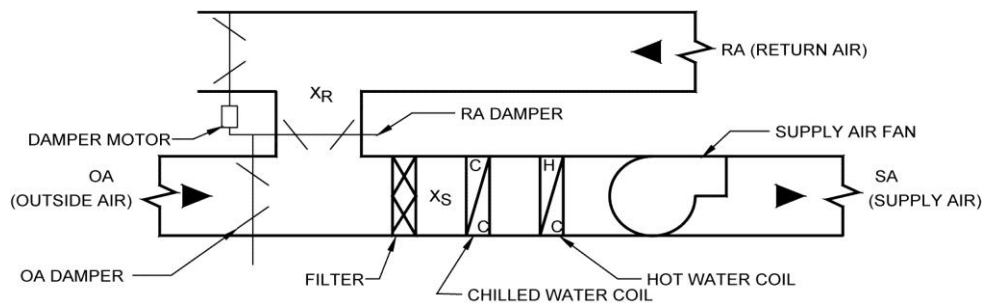


Illustration 1: Air Handling Unit Schematic

If temperature is the measurement used, then the return air value should be taken as close to the air handling unit as possible before the air is mixed with outdoor air. In the illustration given, the return air temperature (X_R) would best be taken in the return air duct just upstream of the return air damper. The supply air should be measured before the air has been conditioned. Temperature measurements should also be taken before any fans, since a fan can increase the temperature up to a few degrees. In the illustration given, the supply air temperature (X_S) would best be taken between the filter and the chilled water coil.

(continued on next page)

Equation Errors

If the equation results in a negative percentage or a percent above 100%, then this is an equation error. If the supply air value does not fall between the return air value and the outdoor air value, then an error will occur. Typically, if all three measurements are retaken, the issue will resolve itself. If not, then consider which of the following might apply to the situation:

If using temperature to calculate %OA:

- Air has been conditioned before measurement—take measurement closer to the air handling unit.
- Supply air has been mixed with room air—take supply measurement closer to diffuser or inside duct.
- Return air has not been mixed enough—take return air measurement in duct to assure proper mixing.
- Outdoor and inside temperatures are too close to one another—use CO₂ values as a base for %OA calculations.

If using CO₂:

- Supply air is mixing with room air—take measurement closer to diffuser or inside supply duct.
- Return air is not mixed well—take measurement inside return duct.
- Outdoor air measurement is tainted—make sure air entering outdoor air intake is fresh and clean.
- Not enough occupants to generate CO₂—use temperature values as a base for %OA calculations.

When to Use CO₂ or Temperature to Calculate % Outdoor Air

Percent outdoor air can be calculated using either CO₂ or using temperature. There are benefits to both of these methods and it's important to understand when to use one over the other.

Generally, CO₂ should be used when the building that you are interested in has a lot of occupants. This ensures that the CO₂ concentration values of outdoor air and return air are far apart. If there are a sufficient number of occupants then outdoor air should always be the lowest value, and return air should always be the highest. The further these two values are apart, the more accurate the %OA value will be. If there are few or no occupants, then there is little accumulation of CO₂ and the accuracy will not be as good.

Similarly, temperature should be used when the building or room of interest has a big difference in temperature from outdoor air temperatures. This means when it is hot or when it is cold outdoors, then it is a good time to use temperature as a means to calculate %OA. To take a temperature calculated %OA value, take the measurements at the Air Handling Unit. This means that the measurement will indicate the %OA for an entire area of the building, or the entire building depending on what area or areas the air handling unit serves. The reason the measurements need to be taken at the air handling unit is because there are often heating or cooling coils in the ducts or near the diffusers in some buildings which would adversely affect the readings and it is difficult to verify if they are present or not.

What are Acceptable %OA Values

This is a popular question and it does not have an easy answer. There is no ideal %OA value because it depends on the air flow. If your air flow is high for the number of occupants, you may not need a high %OA. For instance, if you are delivering 1,000 CFM and there are 10 occupants in an office area, you would only need 20% OA to achieve the ASHRAE recommended 20 CFM/person.

$$(1,000\text{CFM} \times 20\% \text{OA}) / 10 \text{ people} = 20\text{CFM/person}$$

However, if you are only delivering 250 CFM in this same scenario with 10 occupants in the same office area, you would need 80% OA to achieve the 20 CFM/person recommendation.

$$(250\text{CFM} \times 80\% \text{OA}) / 10 \text{ people} = 20 \text{ CFM/person}$$

There is no easy answer to this question because the answer varies with the air flow and the maximum number of occupants. The best thing to do is to measure the air flow and find the maximum number of people that will be in the room. Then the following equation can be used to find the %OA that would be needed:

$$\% \text{OA} = (\text{CFM/person OA recommended} \times \text{maximum number of occupants}) / \text{air flow}$$

As an example, consider an office space where 20 CFM/person of outdoor air is recommended, where the maximum number of occupants is 30 and the air flow is 1,800 CFM:

$$\% \text{OA recommended} = (20 \text{ CFM/person} \times 30) / 1,800 \text{ CFM} = 33.3\% \text{ outdoor air recommended}$$

References

¹ TSI Application Note *Traversing a Duct to Determine Average Air Velocity or Volume*. AF-106.



Airflow Instruments, TSI Instruments Ltd.

Visit our website at www.airflowinstruments.co.uk for more information.

UK Tel: +44 149 4 459200
France Tel: +33 4 91 11 87 64

Germany Tel: +49 241 523030